

## PRESSURE REDUCING VALVE RP45

### DESCRIPTION

The ADCA RP45 series pressure reducing valves are single seat bellows sealed controllers, operating without auxiliary energy, designed for use on steam, compressed air, industrial inert gases and liquids compatible with the construction.

They are particularly suitable for reducing steam pressure in all energy and process systems where pressures should be kept constant.

Connections are flanged.

### OPERATION

Pressure reduction is achieved by means of variable throttling of the inlet flow at the valve seat by variation of the flow area between seat and disc. The outlet pressure which is transmitted through the feed-back line to the diaphragm chamber counteracts the spring force acting on the valve spindle and controls the valve aperture corresponding to the spring setting and thus to the required outlet pressure.

### MAIN FEATURES

Bellows specially designed for high durability.

Robust construction (fit-and-forget).

Suitable for use with high pressure turndowns.

### OPTIONS:

Nitrile rubber soft seated version for air and gas applications where tight shut-off is required.

### USE:

Saturated steam, compressed air and other gases and liquids compatible with the construction.

### AVAILABLE

#### MODELS:

RP45G and RP45GN – PN16 cast iron  
RP45S and RP45SN – PN40 cast steel  
Suffix N : soft seated with nitrile rubber

#### SIZES:

DN 15 to DN 100

#### CONNECTIONS:

RP45G Flanged EN 1092-2 PN16  
RP45S Flanged EN 1092-1 PN40

#### INSTALLATION:

Horizontal installation.

An "Y" strainer , steam separator and steam trap should be provided upstream the valve.

See IMI, installation and maintenance instructions.




CE MARKING (PED - European Directive 97/23/EC)		
PN 16	PN 40	Category
DN15 to DN50	DN15 to DN32	SEP - art. 3, paragraph3
DN65 to DN100	DN40 to DN80	1 (CE Marked)
/	DN100	2 (CE Marked)

LIMITING CONDITIONS				
	RP45G Cast iron	RP45S Cast steel	RP45GN * Cast iron	RP45SN * Cast steel
Body design conditions	PN16	PN40	PN16	PN40
Max.upstream pressure	13 bar	25 bar	13 bar	25 bar
Max.downstream pressure	13 bar	13 bar	13 bar	13 bar
Min.downstream pressure	0,15 bar	0,15 bar	0,15 bar	0,15 bar
Max.operating temperature	200°C	250°C	90 °C	90 °C
Max.reducing ratio	25:1	25:1	10:1	10:1
Max.cold hydraulic test	24 bar	25 bar	24 bar	25 bar
Max.hydraulic factory valve body test	24 bar	60 bar	24 bar	60 bar

\*Suffix N : - a maximum turndown ratio 10:1 should be observed.

PTFE can also be offered in alternative.


DIMENSIONS (mm)						
VALVE				ACTUATOR		
SIZE DN	A	B	WGT. Kgs	TYPE	C	WGT. Kgs
15	130	440	12,7	A1	172	4,3
20	150	440	12,7	A11	172	4,3
25	160	440	13,7	A2	220	7,3
32	180	445	15,7	A21	220	7,3
40	200	445	17,7	A3	282	11,3
50	230	540	25,7	A4	340	16,3
65	290	540	29,7			
80	310	610	36,7			
100	350	650	53,7			

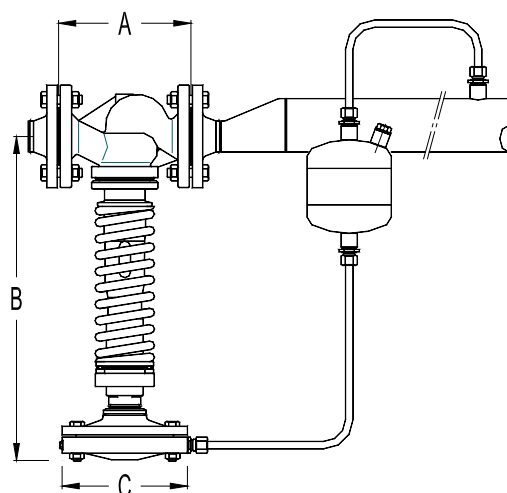

MATERIALS		
POS.	DESIGNATION	MATERIAL
1	Valve body (PN16)	GJL-250 / 0.6025
1	Valve body (PN40)	GP240GH / 1.0619
2	Piston body	GJS-400-15 / 0.7040
3	Valve seat	HARDENED ST. STEEL
4	* Valve disc	HARDENED ST. STEEL
4	* Soft valve disc	AISI 304 / 1.4301 ; NBR
5	Guide	AISI 304 / 1.4301
6	* Bellows	AISI 316 Ti / 1.4571
7	* Diaphragm chamber	GJL-250 / 0.6025
8	Spindle	AISI 304 / 1.4301
9	Regulating spring	SPRING STEEL
10	* Impulse line	COPPER
11	* Condensate vessel a)	S235JRG2 / 1.0038

\* Available spare parts.

a) Not necessary when in operation with low temperature compressed air or water.

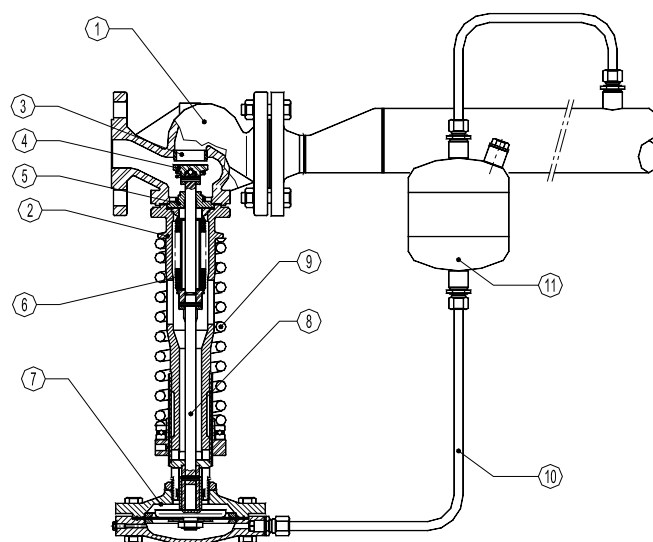



SATURATED STEAM CAPACITY TABLE (Kg/h) ( P2 < 0,58 P1 )									
INLET bar	VALVE SIZE								
	DN15	DN20	DN25	DN32	DN40	DN50	DN65	DN80	DN100
0,5	51	68	90	118	186	300	460	800	1250
0,75	63	84	112	146	230	360	580	1000	1550
1	75	100	133	175	280	430	700	1200	1850
1,5	100	133	175	240	360	590	910	1600	2500
2	126	170	230	290	450	730	1160	2000	3050
2,5	150	200	260	350	550	880	1390	2400	3600
3	175	240	310	400	640	1010	1600	2700	4300
4	220	290	390	510	800	1300	2000	3400	5400
5	260	350	480	620	1000	1600	2500	4200	6500
6	330	440	580	760	1220	1930	3000	5100	8000
7	400	520	700	910	1430	2300	3600	6100	9500
8	450	600	800	1040	1670	2700	4100	7100	11000
9	500	670	880	1180	1800	2900	4600	7800	12000
10	560	750	980	1300	2000	3200	5100	8500	13500
12	680	900	1180	1540	2500	4000	6100	10500	16300
14	800	1050	1400	1850	2900	4700	7200	12600	19000
16	920	1230	1630	2150	3400	5500	8300	14600	22000
18	1040	1400	1860	2450	3800	6200	9500	16600	25000
20	1170	1540	2100	2700	4200	7000	10800	18600	28000
22	1330	1780	2350	3050	4900	7800	12200	21000	32000
24	1500	2000	2600	3400	5400	8700	13700	23500	36000
25	1600	2150	2800	3600	5700	9200	14500	25500	38000



ACTUATOR AND SPRING SELECTION TABLE								
VALVE SIZE DN	Kvs m3/h	ACTUATOR						
			A-4	A-3	A-2	A-21	A-1	A-11
15	4,8	Outlet (bar) Spring N°.	0,5 - 0,99 60	1,0 - 1,6 60	1,7 - 3,8 60	3,9 - 5,5 60	5,6 - 8,2 60	8,3 - 13 60
20	6,9	Outlet (bar) Spring N°.	0,5 - 0,99 60	1,0 - 1,6 60	1,7 - 3,8 60	3,9 - 5,5 60	5,6 - 8,2 60	8,3 - 13 60
25	9,1	Outlet (bar) Spring N°.	0,5 - 0,99 60	1,0 - 1,6 60	1,7 - 3,8 60	3,9 - 5,5 60	5,6 - 8,2 60	8,3 - 13 60
32	11,8	Outlet (bar) Spring N°.	0,5 - 0,99 60	1,0 - 1,6 60	1,7 - 3,8 60	3,9 - 5,5 60	5,6 - 8,2 60	8,3 - 13 60
40	14,4	Outlet (bar) Spring N°.	0,5 - 0,99 60	1,0 - 1,6 60	1,7 - 3,8 60	3,9 - 5,5 60	5,6 - 8,2 60	8,3 - 13 60
50	26,5	Outlet (bar) Spring N°.	0,5 - 0,99 61	1,0 - 1,9 61	2,0 - 4,2 61	4,3 - 6,9 61	7 - 8,5 64	8,6 - 13 64
65	51,5	Outlet (bar) Spring N°.	0,5 - 0,99 61	1,0 - 1,9 61	2,0 - 4,2 61	4,3 - 6,9 61	7 - 8,5 64	8,6 - 13 64
80	79,5	Outlet (bar) Spring N°.	0,46 - 0,99 62	1,0 - 1,9 62	2 - 5 62	5,1 - 8,9 62	9 - 13 65	/
100	129,5	Outlet (bar) Spring N°.	0,46 - 0,99 63	1,0 - 1,9 63	2 - 6 63	6,1 - 13 63	/	/

**Correction factors:**

The given capacities apply to the pressure reducing valves at **critical pressure drop** (downstream pressure in barg about 58% of the upstream pressure barg or lower). In case of **non-critical pressure drop** a correction factor must be used as follows:

PRESSURE RATIO * P2 / P1	CORRECTION FACTOR f
≥ 0,7	1,25
≥ 0,8	1,6
≥ 0,9	2,25

No correction factor should be used for smaller pressure ratios than 0.7.

\* Pressure ratio in bar abs (barg + 1)

**Superheated steam:**

If superheated steam is to be reduced instead of saturated steam a correction factor has to be applied as well, the required mass flow must be multiplied by the following factor :

$$\frac{V_h}{V_s}$$

where Vh = specific volume of superheated steam and Vs = specific volume of saturated steam .

Remarks: maximum temperature PN16 – 200°C ; PN40 – 250°C.

**HOW TO SIZE ( using table for steam )**

**Example (valve selection) :** Saturated steam capacity: 300Kg/h; Upstream pressure: 3 bar; Downstream pressure required: 2bar.

**Solution:** First determine correction factor for pressure ratio:  $\frac{2+1}{3+1} = 0.75 \rightarrow f = 1.25$ .

Then multiply the given capacity:  $300 \times 1.25 = 375 \text{ Kg/h}$



Go to 3 bar in the column “bar” of the capacity table. By following the horizontal line you can find out the values for selection of pressure reducing valve. Looking for an equal or higher value than 300 Kg/h. In this case it will be 400 Kg/h. Now, go to the top of the table and read off the nominal size: DN32

On the actuator and spring selection table, for downstream pressure of 2 bar we may see that the recommended actuator is type A-2, considering the valve supplied with spring Nr.60.

**How to order:** RP45G DN32 PN16 valve complete with spring Nr.60, type A-2 actuator, condensate vessel and copper tube impulse line.

**HOW TO SIZE ( using Kvs ) :** please consult formulas on IS PV10.00 E or consult factory.

### Typical Installation

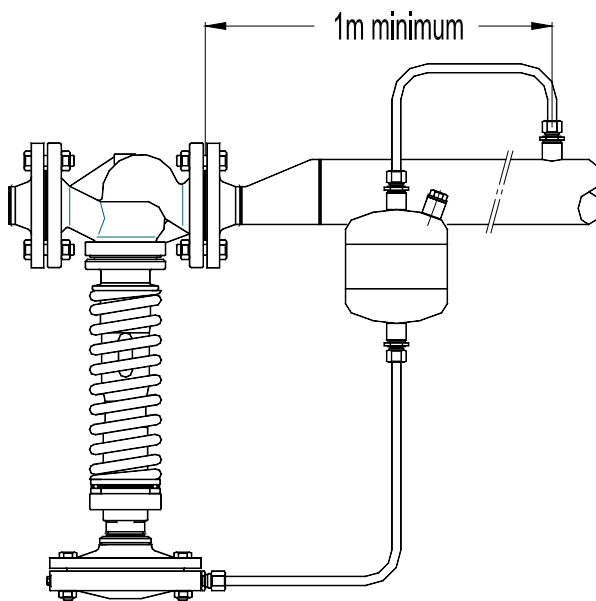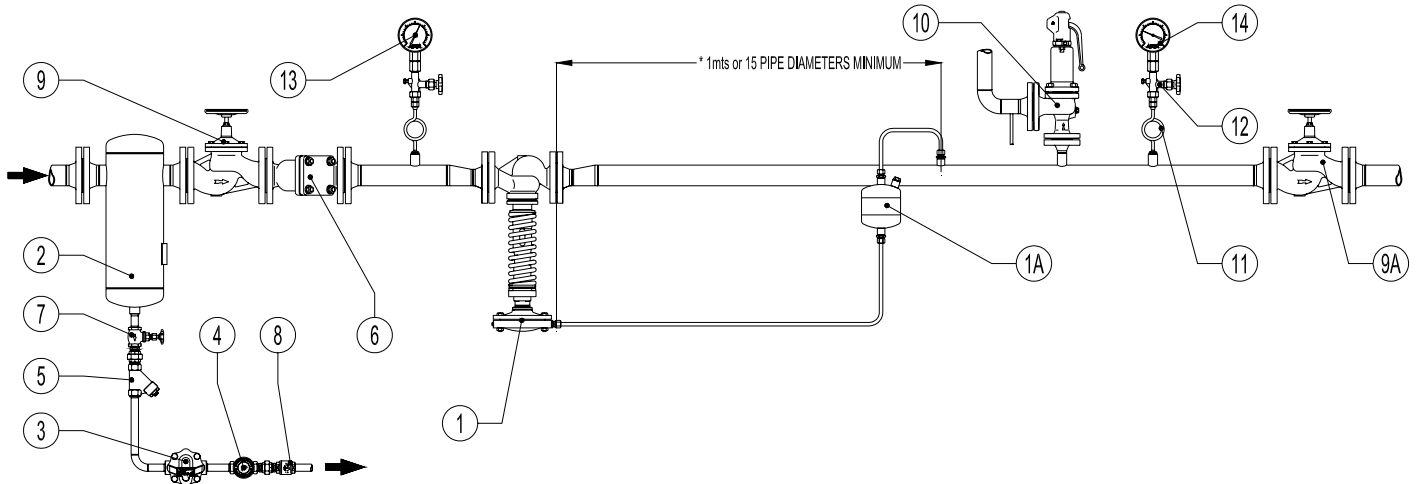

MATERIALS		
POS.	DESIGNATION	MODEL
1	Pressure reducing valve	ADCA RP45
1A	Water seal pot	POP
2	Humidity separator	ADCA S 25
3	Steam trap	ADCA FLT series
4	Sigh glass	ADCA SW 12
5	Y Strainer	ADCA IS 16
6	Y Strainer	ADCA IS16F
7	Stop valve	ADCA GV32B
8	Check valve	ADCA RT
9	Stop valve	ADCA VF16
9A	Stop valve	ADCA VF16
10	Safety valve	-
11	Coil	ADCA GSC-40
12	Gauge cock	ADCA GC-400
13	Upstream pressure gauge	ADCA MAN-100
14	Downstream pressure gauge	ADCA MAN-100

Remarks :

**By-pass** : if overpressure can not be accepted the use of by-pass is not recommended. In alternative , for critical process, two pressure reducing stations should be installed in parallel.

PN ratings and materials according to the operating pressures.

\* The balance pipe connection is recommended to enter downstream pipe at a minimum of 1 meter from valve.

Installation instructions are available (IMI-RP45) and typical assembling drawing.

Special assembling designs may be produced on request.