


ADCATHERM STH SHELL & TUBE HEAT EXCHANGER Typical Installation

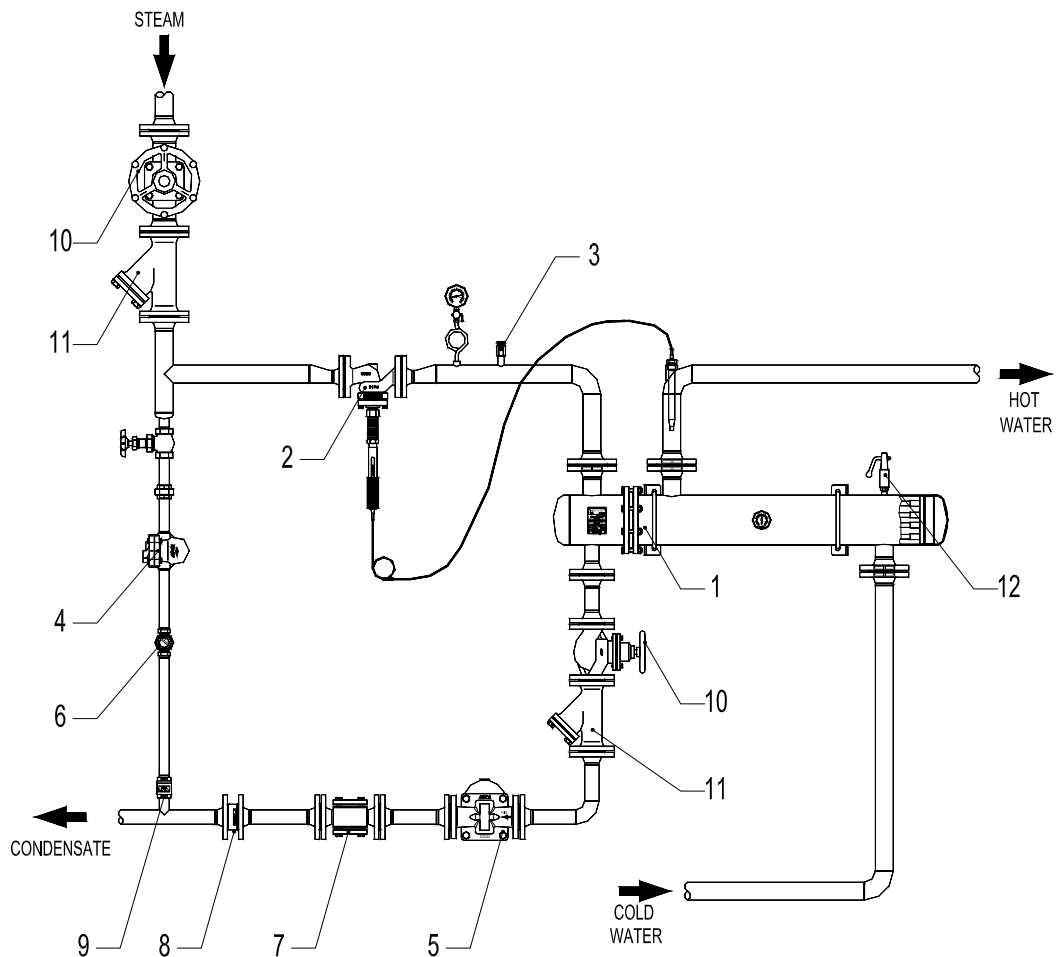

MATERIALS

POS.	DESIGNATION	MODEL
1	HEAT EXCHANGER	STH
2	SELF OPERATED CONTROLLER	TR
3	VACUUM BREAKER	VB 21
4	DRIP LEG STEAM TRAP	TSS 22
5	FLOAT&THERMOST.STEAM TRAP	FLT
6	SIGH GLASS	SW
7	SIGH GLASS	DW
8	CHECK VALVE	RD 40
9	CHECK VALVE	RT 25
10	GLOBE VALVE	---
11	Y STRAINER	IS16F
12	SAFETY VALVE	---

Remarks :

Materials according to the operating pressures.
Different assembling designs may be produced on request .